


PROJECT:

DATE:

PANEL #:

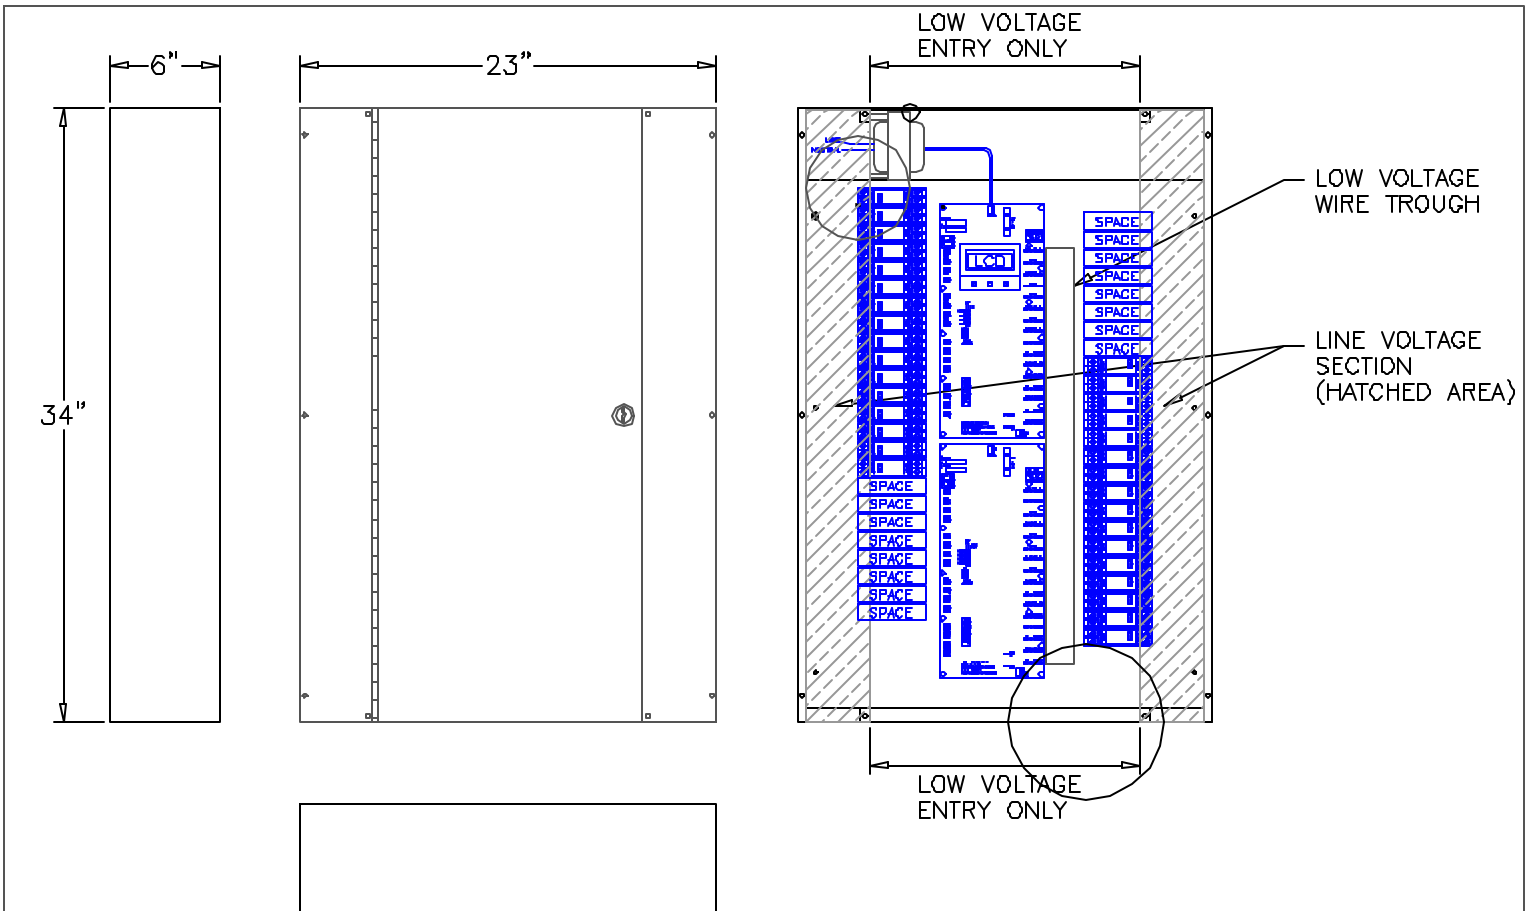

TYPICAL LCS 2-X-2 PANEL/RELAY LAYOUT

NOTES:

1. UP TO 32 INDIVIDUALLY CONTROLLED RELAYS WITH SPACE FOR ADD'L 16.
2. ONE BELDEN 9842 SHIELDED CABLE REQ'D TO INTERCONNECT EACH RPP CONTROL PANEL OR TO PC
3. REFER TO PANEL SPECS. FOR TRANSFORMER POWER SUPPLY REQUIREMENTS