


1. Override Switch and Relay Connections

Override switch input pairs are designated S1, S1 to S16, S16 and corresponding LED inputs are designated L1+, L1- to L16+, L16-. If LED's are not present, omit LED wiring. Switch and LED wiring to be 18 AWG, stranded. Relay outputs are designated RLY1 through RLY16. See I/O sheets for input-to-relay assignments. Relay wiring to be 20 AWG, stranded. Connect override switches and relays as follows:



1. Override Switch and Relay Connection (cont.)

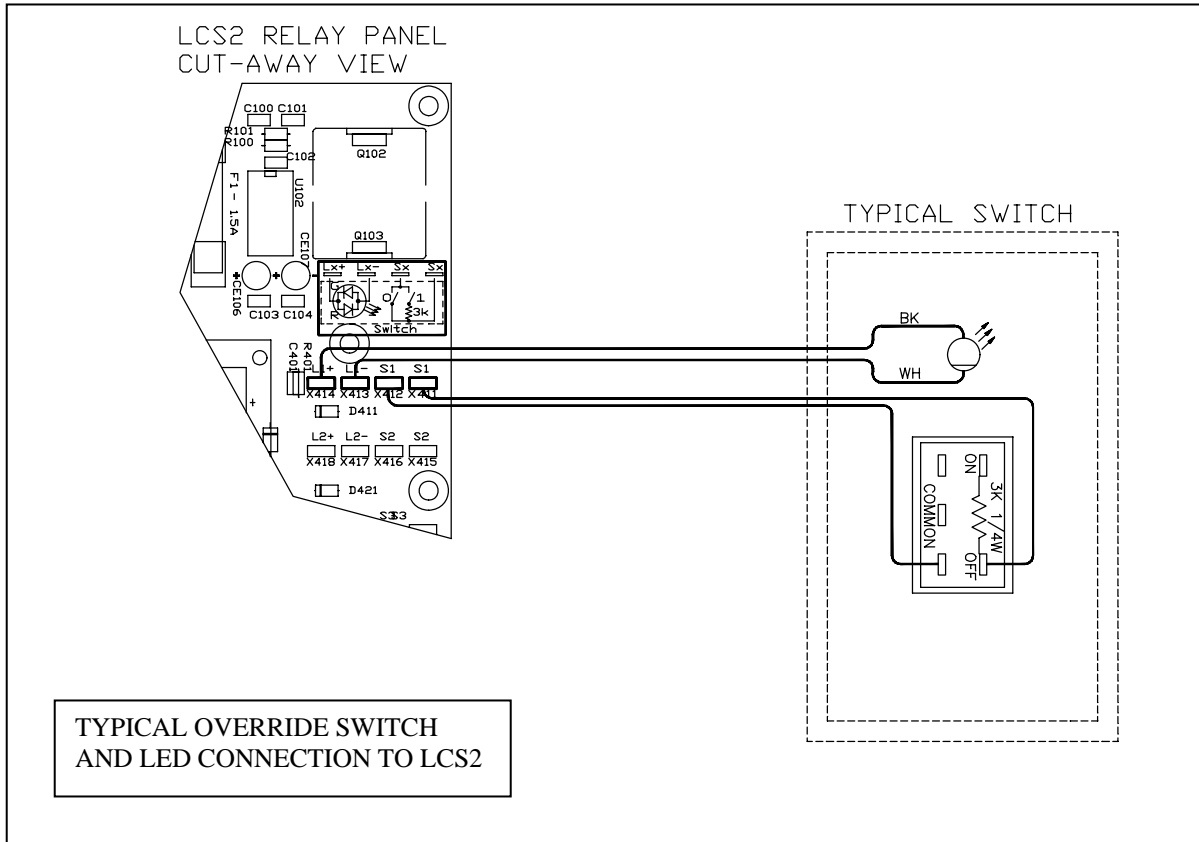